

Results of Tests on Brick conducted in accordance with ASTM C67-09 Standard Method for Sampling and

Testing Brick and Structural Clay Tile

11/03/2011

Name:	Pine Hall Brick Company, Inc 10000 Fairmount Highway SE Fairmount, GA 30139	Plant:	Fairmount
Phone:		Report Number:	PHB-0058
Fax:		Sampled Date:	10/18/2011
		Lot:	
		Product Code:	

Sample Description: **Canterra 4 x 8 Paver**

						Average	Test Date
Absorption	1	2	3	4	5		
24 Hour Submersion in Cold Water (%)	3.85	3.55	4.30	3.47	4.35	3.91	10/21/2011
5 Hour Submersion in Boiling Water (%)	5.29	4.77	5.61	4.82	5.55	5.21	
Saturation Coefficient (Ratio of 24H to 5H)	0.73	0.74	0.77	0.72	0.78	0.75	
Compressive Strength	1	2	3	4	5	Average	
<i>psi</i>	20,196	19,157	23,336	22,600	21,938	21,446	10/20/2011
<i>MPa</i>	139.2	132.1	160.9	155.8	151.3	147.9	
Efflorescence	11	12	13	14	15		
	Not Effloresced	Not Effloresced	Not Effloresced	Not Effloresced	Not Effloresced		10/27/2011
Abrasion Resistance	1	2	3	4	5	Average	
	0.02	0.02	0.02	0.02	0.02	0.02	10/27/2011

The brick represented by the test results shown here comply with the standards listed below:

ASTM C 1272 - 10 Standard Specification for Heavy Vehicular Paving Brick

Type: R


ASTM C 902 - 10 Standard Specification for Pedestrian and Light Traffic Paving Brick

Class: SX, MX, NX

Type: I, II, III



John Sanders, Ph.D., PE, Associate Director for Operations

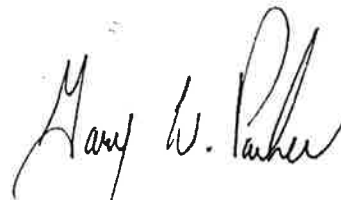

Gary W. Parker, Laboratory Supervisor